



Appendix I Infrastructure Doping Control Station for blood and urine testing

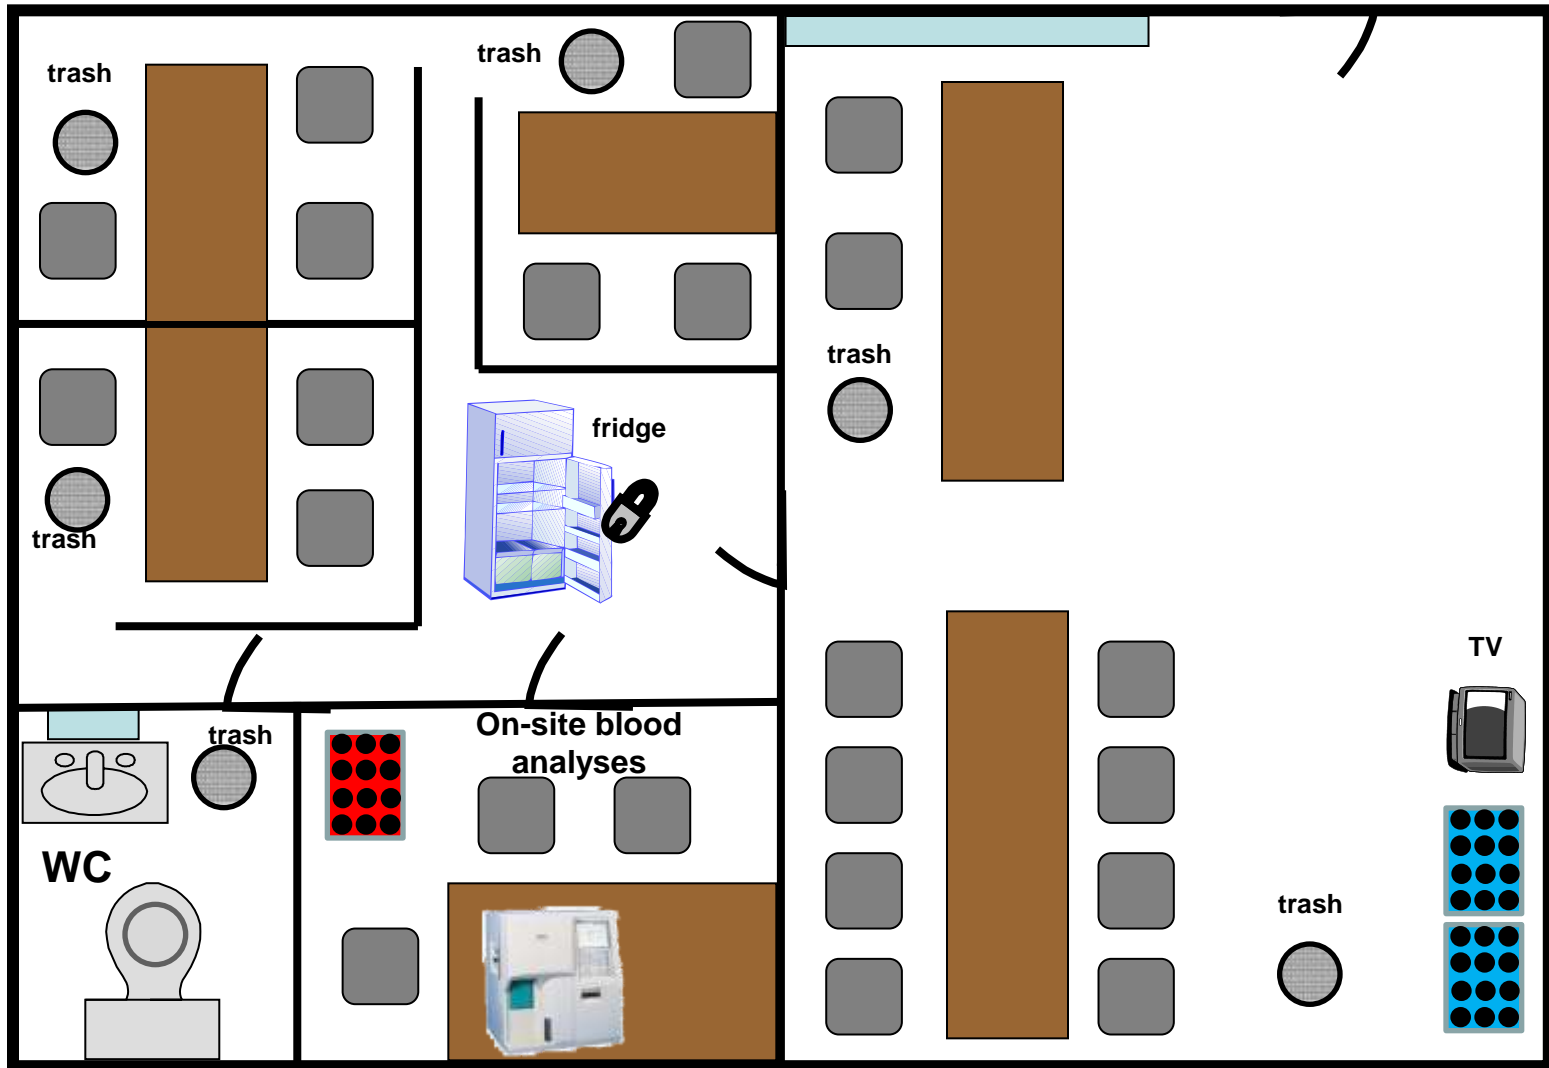

- Laboratory room:**
- Power outlet/electricity
 - Temperature 15 – 28 degrees celsius
 - Lockable room

Sealed refreshments

Appendix Infrastructure Doping Control Station for urine testing

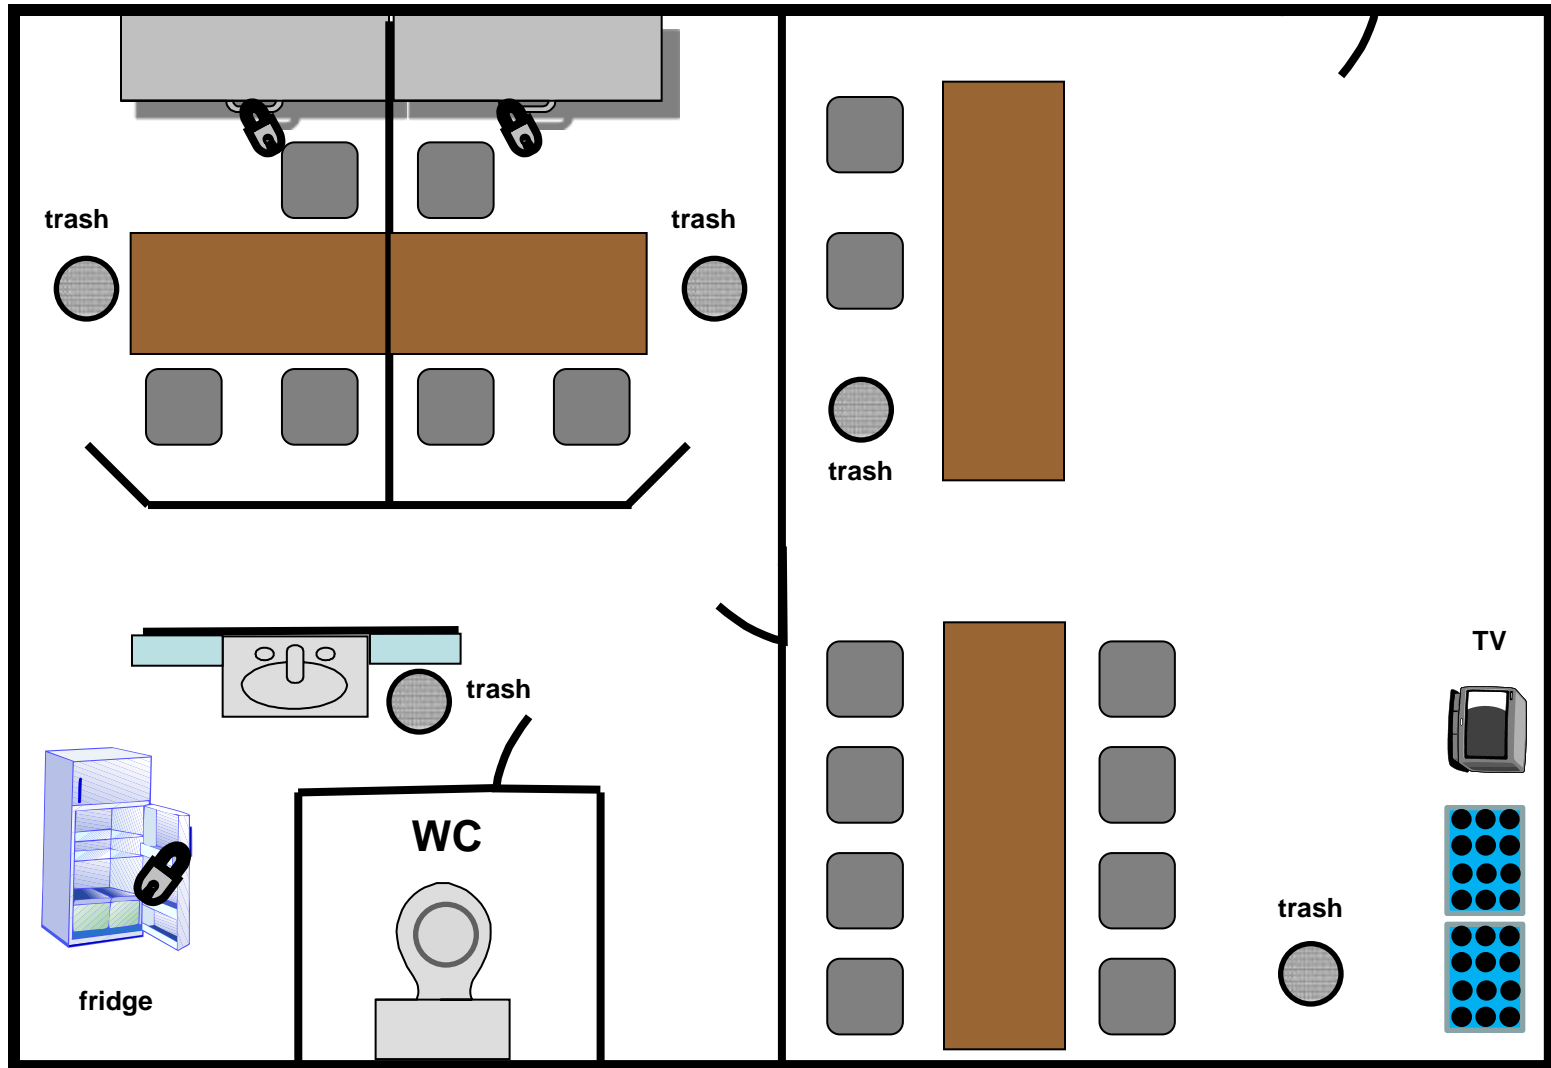

Sealed refreshments